



CERTIFICATE OF ANALYSIS

REPORTED TO Campbell Scientific Canada Corp.
1030 Sugar Lake Rd
Cherryville, BC V0E 2G2

ATTENTION Claude Labine

PO NUMBER

PROJECT Cherryville Water Stewart

PROJECT INFO

WORK ORDER 9032101

RECEIVED / TEMP 2019-03-26 15:50 / 7°C

REPORTED 2019-03-28 16:12

COC NUMBER B77280

Introduction:

CARO Analytical Services is a testing laboratory full of smart, engaged scientists driven to make the world a safer and healthier place. Through our clients' projects we become an essential element for a better world. We employ methods conducted in accordance with recognized professional standards using accepted testing methodologies and quality control efforts. CARO is accredited by the Canadian Association for Laboratories Accreditation (CALA) to ISO 17025:2005 for specific tests listed in the scope of accreditation approved by CALA.

Big Picture Sidekicks



You know that the sample you collected after snowshoeing to site, digging 5 meters, and racing to get it on a plane so you can submit it to the lab for time sensitive results needed to make important and expensive decisions (whew) is VERY important. We know that too.

We've Got Chemistry



It's simple. We figure the more you enjoy working with our fun and engaged team members; the more likely you are to give us continued opportunities to support you.

Ahead of the Curve



Through research, regulation knowledge, and instrumentation, we are your analytical centre for the technical knowledge you need, BEFORE you need it, so you can stay up to date and in the know.


If you have any questions or concerns, please contact me at estclair@caro.ca

Authorized By:

Eilish St.Clair, B.Sc., C.I.T.
Client Service Representative

1-888-311-8846 | www.caro.ca

#110 4011 Viking Way Richmond, BC V6V 2K9 | #102 3677 Highway 97N Kelowna, BC V1X 5C3 | 17225 109 Avenue Edmonton, AB T5S 1H7

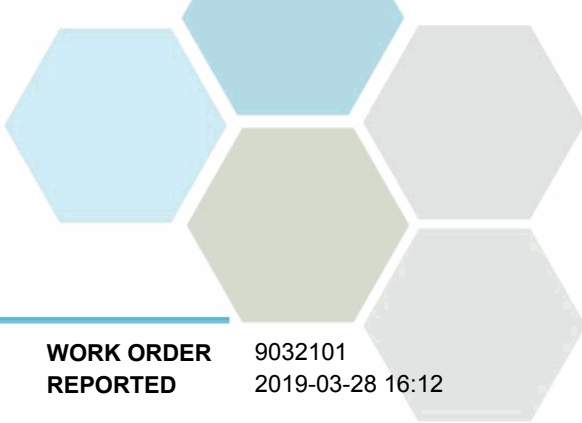

TEST RESULTS

REPORTED TO PROJECT Campbell Scientific Canada Corp.
Cherryville Water Stewart

WORK ORDER REPORTED 9032101
2019-03-28 16:12

Analyte	Result	Guideline	RL	Units	Analyzed	Qualifier
---------	--------	-----------	----	-------	----------	-----------

Shuswap River @ Sihlis Rd (9032101-01) | Matrix: Water | Sampled: 2019-03-26 13:36

Microbiological Parameters

Coliforms, Total	1	MAC = 0	1	CFU/100 mL	2019-03-27	
Background Colonies	> 200	N/A	200	CFU/100 mL	2019-03-27	
Coliforms, Fecal	< 1	N/A	1	CFU/100 mL	2019-03-27	
E. coli	< 1	MAC = 0	1	CFU/100 mL	2019-03-27	

Cherry Creek @ Shuswap River (9032101-02) | Matrix: Water | Sampled: 2019-03-26 13:50

Microbiological Parameters

Coliforms, Total	20	MAC = 0	1	CFU/100 mL	2019-03-27	
Background Colonies	> 200	N/A	200	CFU/100 mL	2019-03-27	
Coliforms, Fecal	2	N/A	1	CFU/100 mL	2019-03-27	
E. coli	2	MAC = 0	1	CFU/100 mL	2019-03-27	

Reitter Creek (9032101-03) | Matrix: Water | Sampled: 2019-03-26 13:33


Microbiological Parameters

Coliforms, Total	26	MAC = 0	1	CFU/100 mL	2019-03-27	
Background Colonies	> 200	N/A	200	CFU/100 mL	2019-03-27	
Coliforms, Fecal	4	N/A	1	CFU/100 mL	2019-03-27	
E. coli	4	MAC = 0	1	CFU/100 mL	2019-03-27	

Shuswap River @ Water Pickup (9032101-04) | Matrix: Water | Sampled: 2019-03-26 14:21

Microbiological Parameters

Coliforms, Total	≥ 8	MAC = 0	1	CFU/100 mL	2019-03-27	
Background Colonies	> 200	N/A	200	CFU/100 mL	2019-03-27	
Coliforms, Fecal	1	N/A	1	CFU/100 mL	2019-03-27	
E. coli	1	MAC = 0	1	CFU/100 mL	2019-03-27	

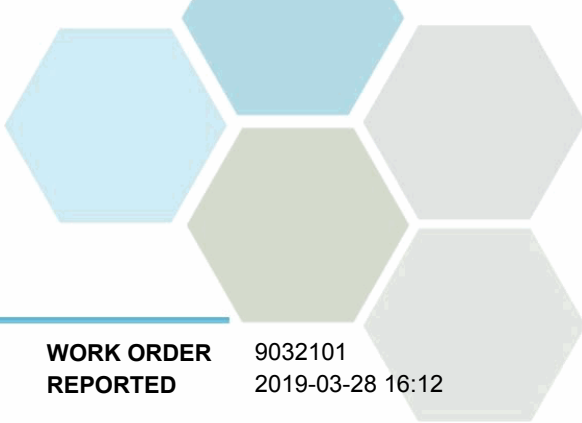

APPENDIX 1: SUPPORTING INFORMATION

REPORTED TO PROJECT Campbell Scientific Canada Corp.
Cherryville Water Stewart

WORK ORDER REPORTED 9032101
2019-03-28 16:12

Analysis Description	Method Ref.	Technique	Location
Coliforms, Fecal in Water	SM 9222 D (2006)	Membrane Filtration / m-FC Agar	Kelowna
Coliforms, Total in Water	SM 9222 B (2006)	Membrane Filtration / m-Endo Agar	Kelowna
E. coli in Water	SM 9222 G (2006)	Membrane Filtration / Nutrient Agar with MUG	Kelowna

Glossary of Terms:

RL	Reporting Limit (default)
<	Less than the specified Reporting Limit (RL) - the actual RL may be higher than the default RL due to various factors
>	Greater than the specified Result
>=	Greater than or equal to the specified Result
CFU/100 mL	Colony Forming Units per 100 millilitres
MAC	Maximum Acceptable Concentration (health based)
SM	Standard Methods for the Examination of Water and Wastewater, American Public Health Association

Guidelines Referenced in this Report:

[Guidelines for Canadian Drinking Water Quality \(Health Canada, Feb 2017\)](#)

Note: In some cases, the values displayed on the report represent the lowest guideline and are to be verified by the end user

General Comments:

The results in this report apply to the samples analyzed in accordance with the Chain of Custody document. This analytical report must be reproduced in its entirety. CARO is not responsible for any loss or damage resulting directly or indirectly from error or omission in the conduct of testing. Liability is limited to the cost of analysis. Samples will be disposed of 30 days after the test report has been issued unless otherwise agreed to in writing. The quality control (QC) data is available upon request

Results in **Bold** indicate values that are above CARO's method reporting limits. Any results that are above regulatory limits are highlighted **red**. Please note that results will only be highlighted red if the regulatory limits are included on the CARO report. Any Bold and/or highlighted results do not take into account method uncertainty. If you would like method